



LEVEL-17 (TOWER-1) PUMP ROOM PLAN
SCALE 1:20

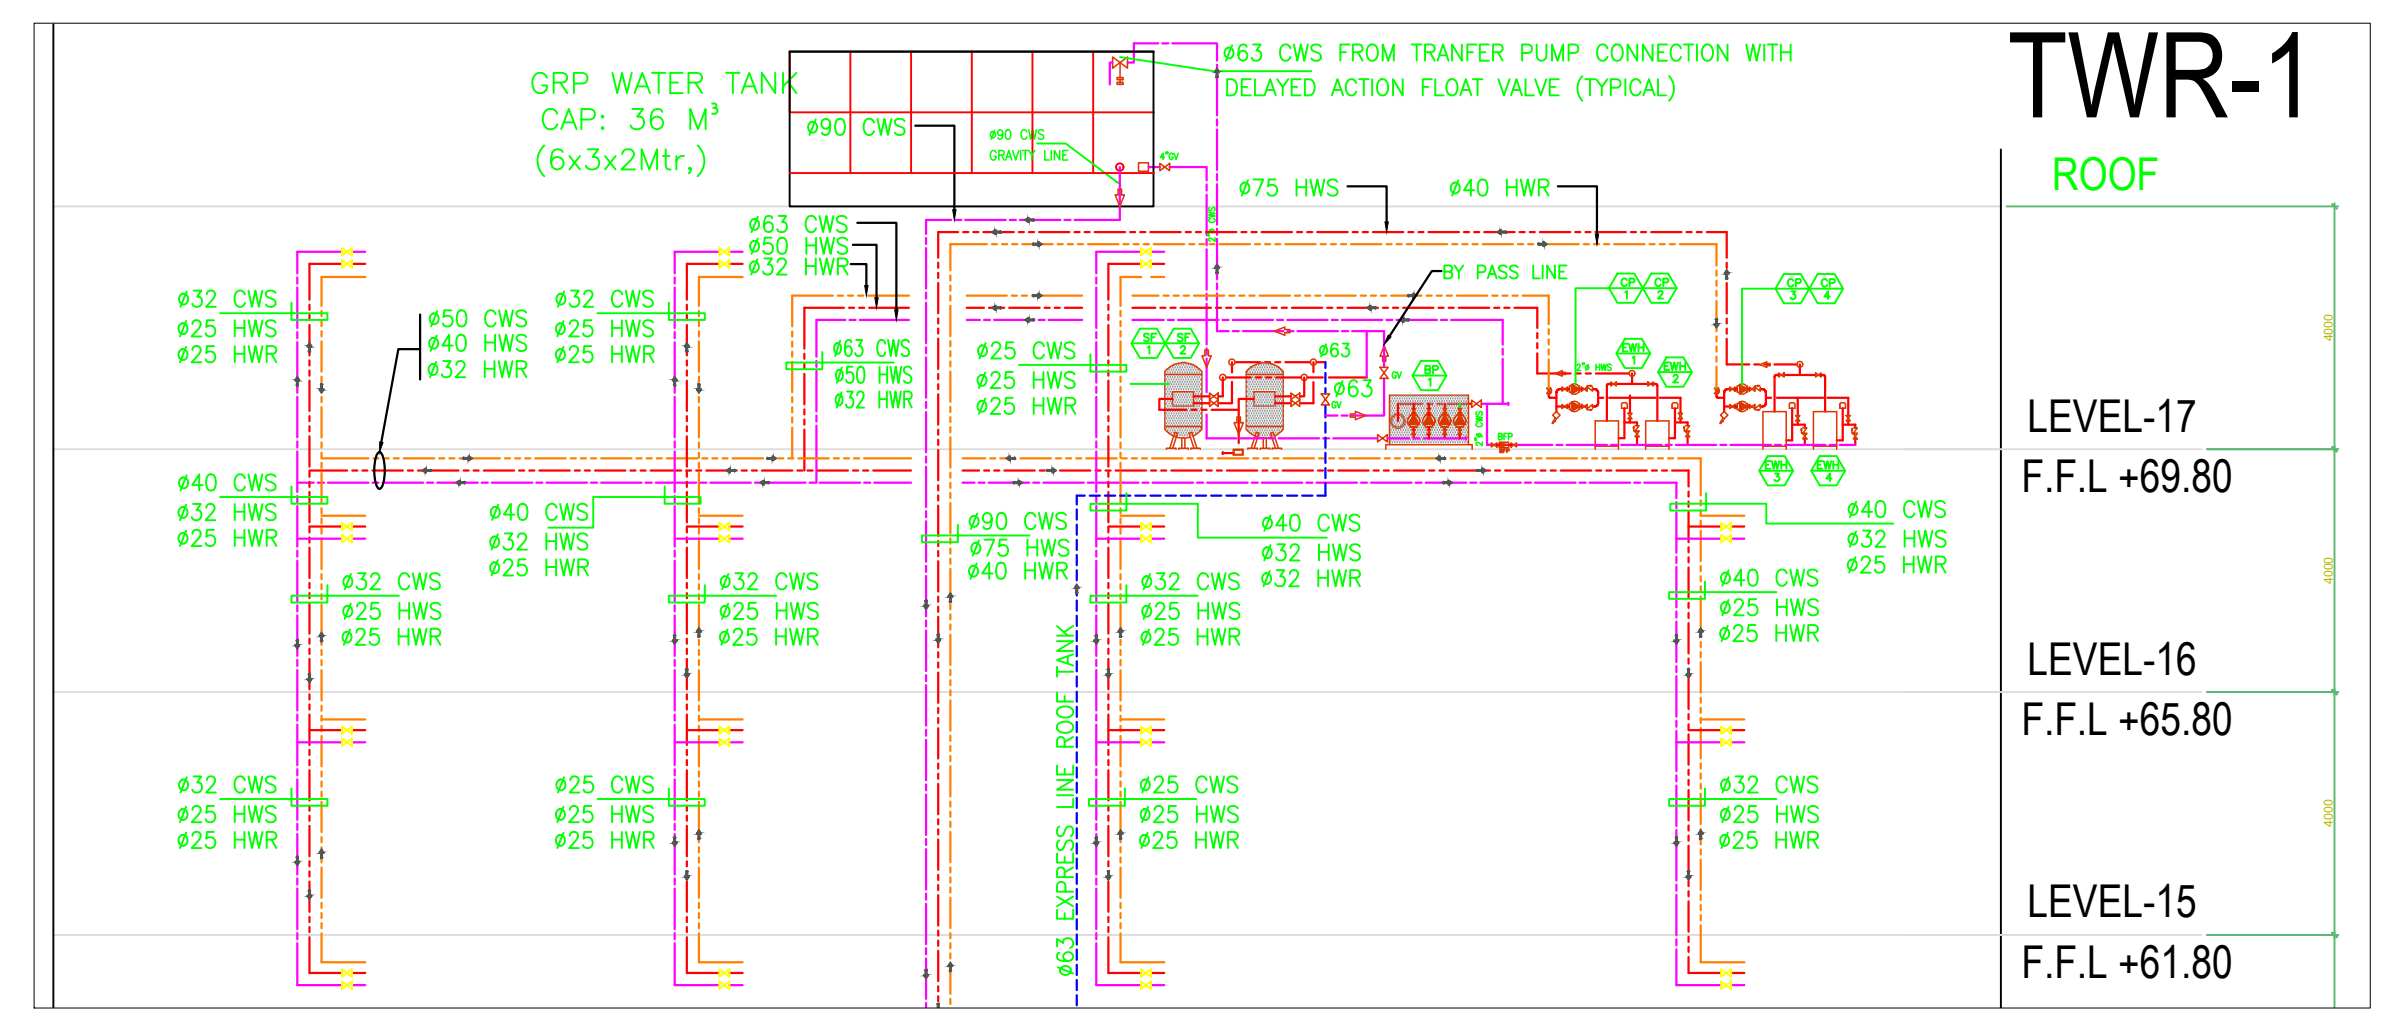


**LEVEL-17 TOWER - 1
RISER DIAGRAM**

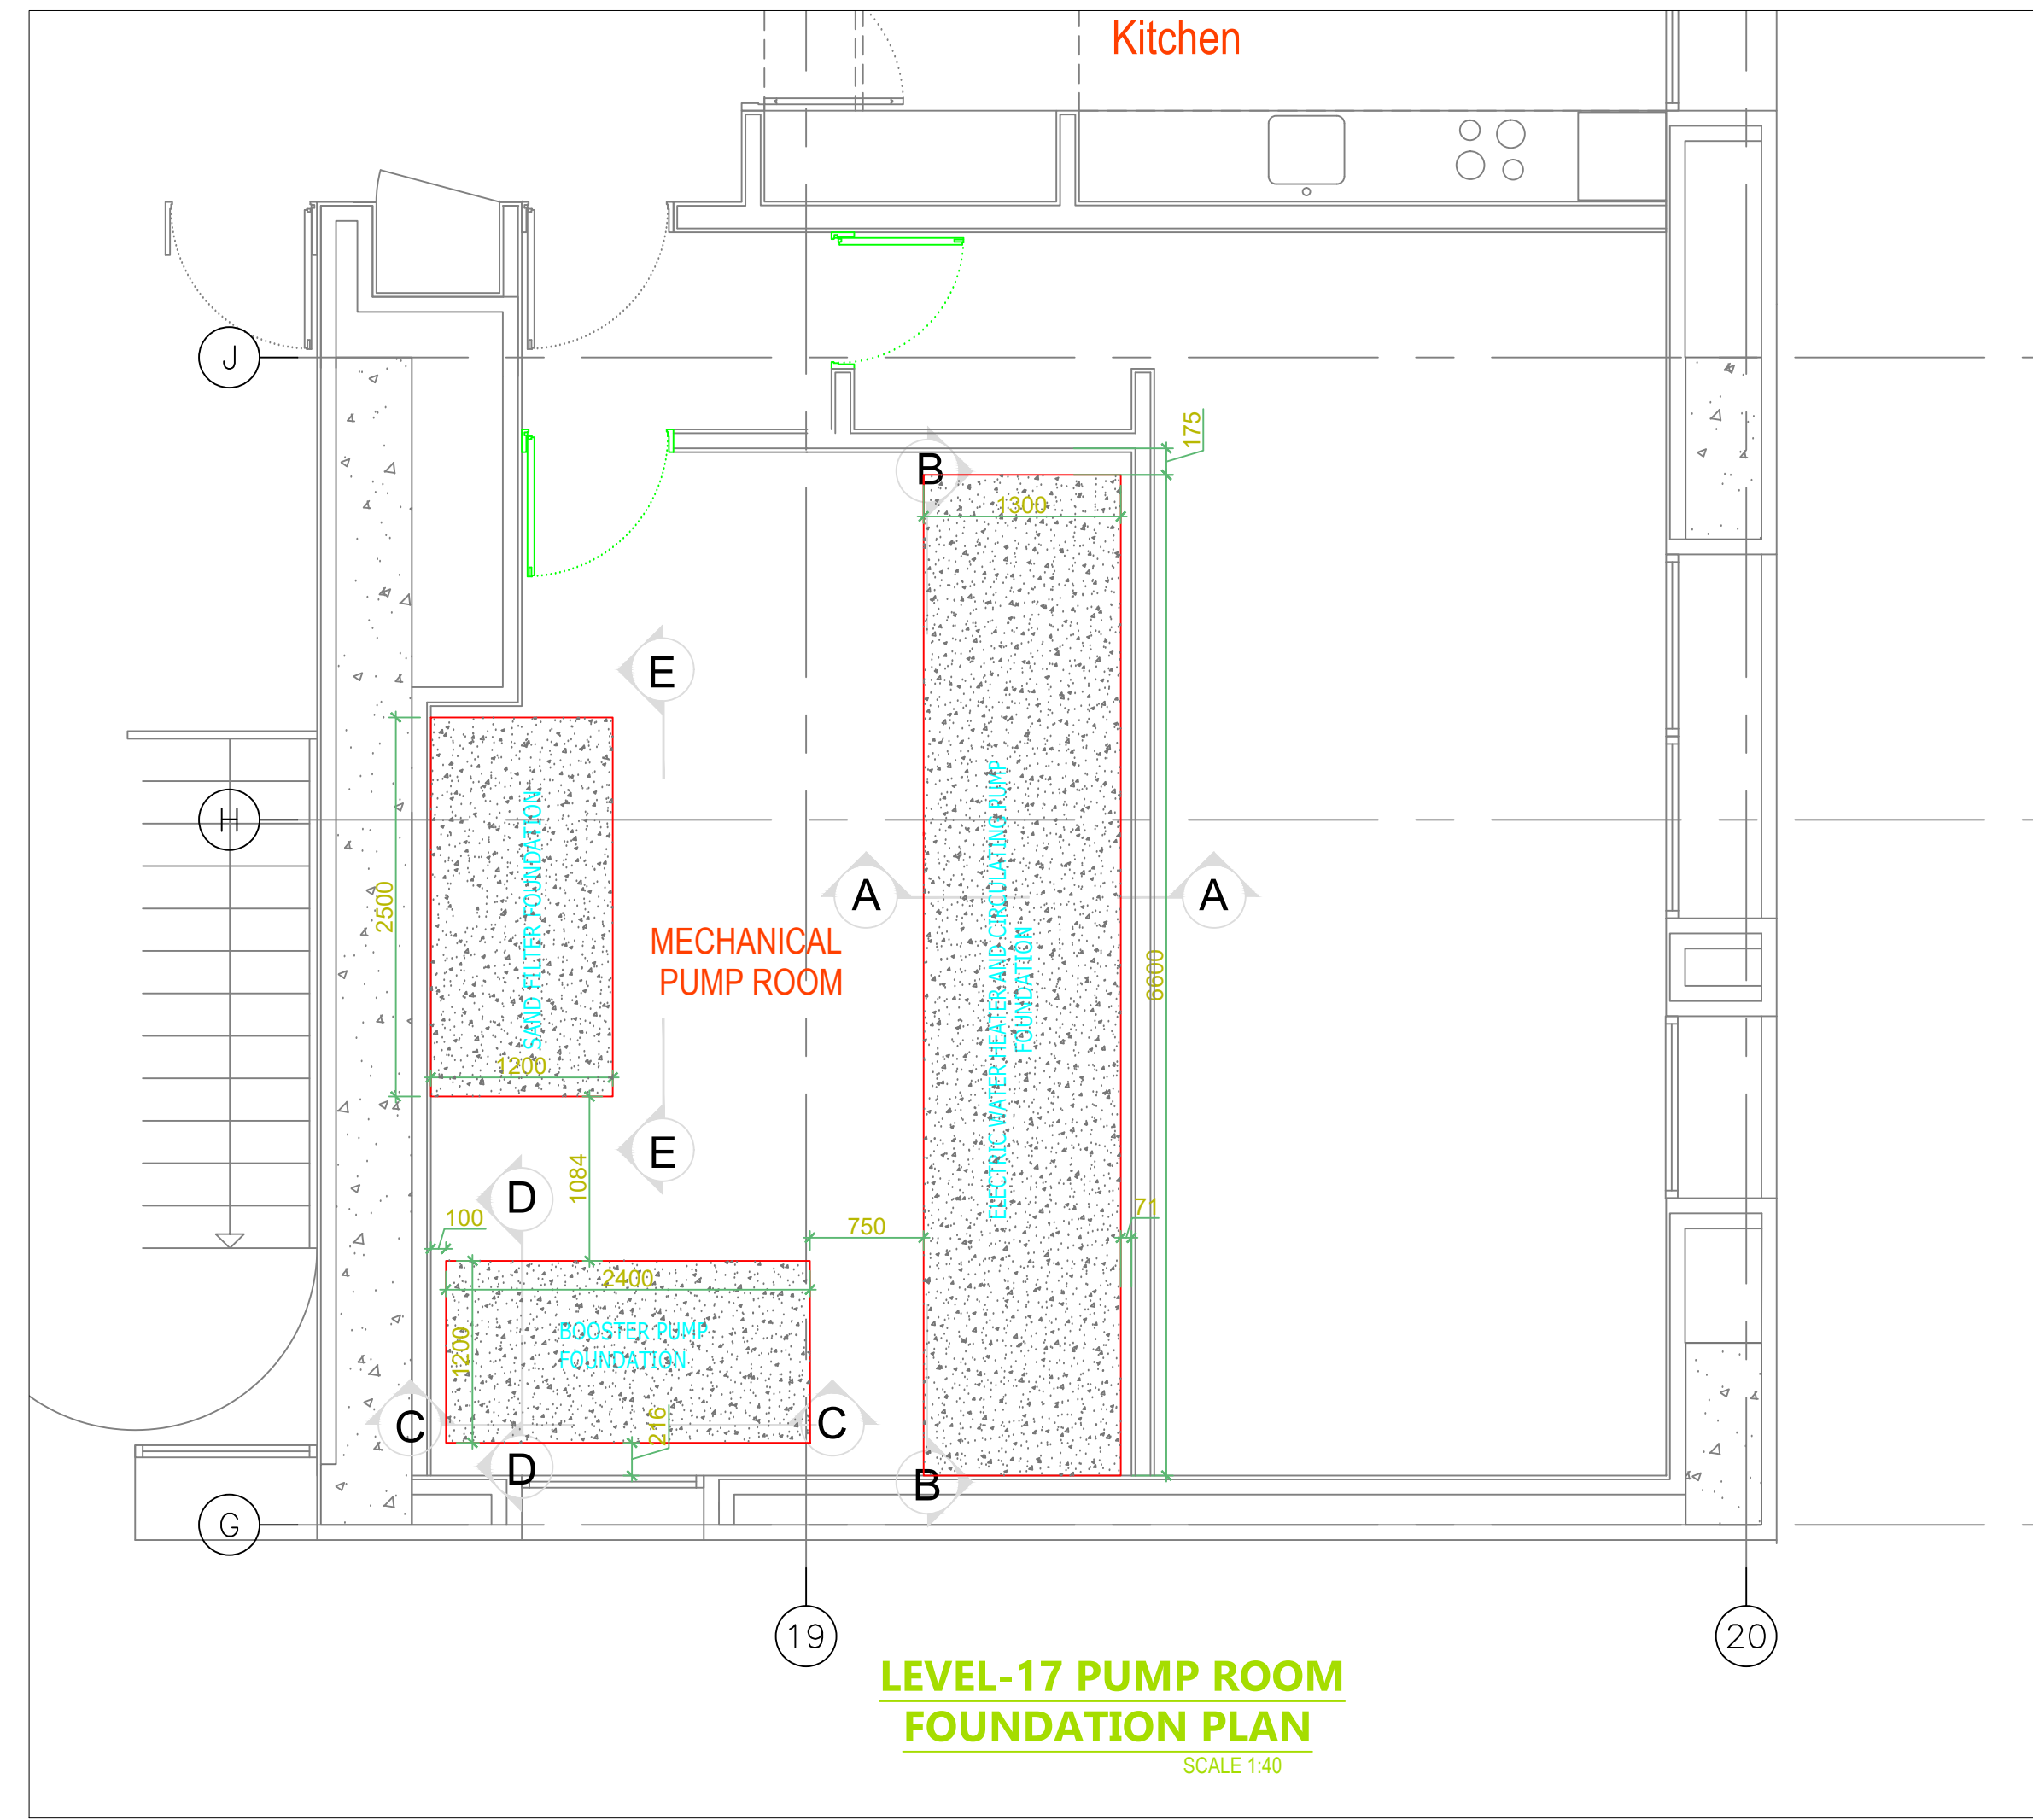


**LEVEL-17 PUMP ROOM
FOUNDATION PLAN**
SCALE 1:40

PUMP EQUIPMENT SCHEDULE


S.No	Description	Identification	Location	Capacity	Remark
1.	Water supply Booster pump (1Set = 4Nos.)	BP 1	17	Capacity: 3.8m ³ /hr @ 15MR TDH (3 Duty + 1 Standby)	
2.	Hot water circulating pump (1Set = 2Nos.)	CP 1, 2	17	Capacity: 2m ³ /hr @ 10MR TDH (1 Duty + 1 Standby)	
3.	Hot water circulating pump (1Set = 2Nos.)	CP 3, 4	17	Capacity: 2m ³ /hr @ 10MR TDH (1 Duty + 1 Standby)	
4.	Electric water Heater 1/2 (1Set = 2Nos.)	EW 1, 2	17	Power: 15Kw @ 120 USG (Both Duty)	
5.	Electric water Heater 3/4 (1Set = 2Nos.)	EW 3, 4	17	Power: 24Kw @ 250 USG (Both Duty)	
6.	Central sand filter (1Set = 2Nos.)	SF 1, 2	17	Capacity: 10m ³ /hr. (Both Duty)	

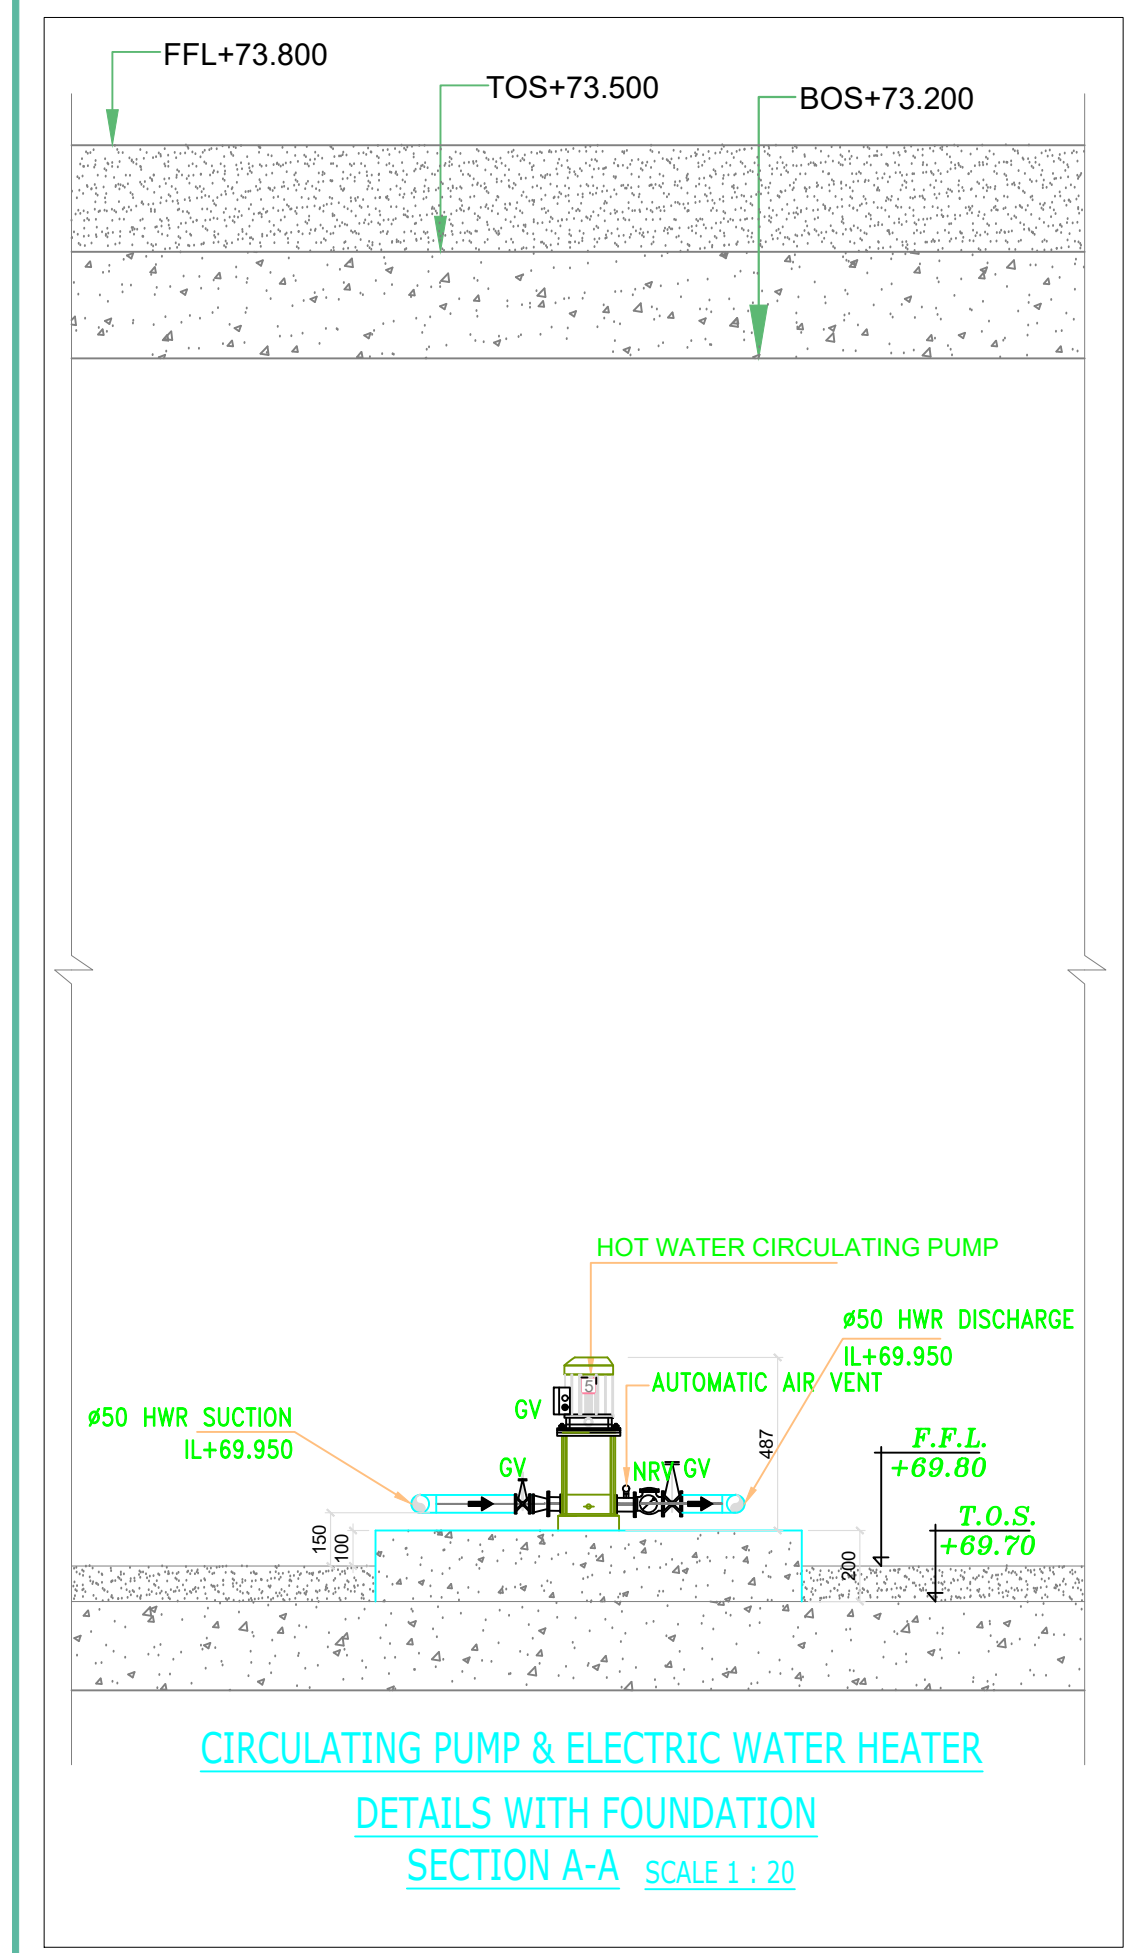


**CIRCULATING PUMP & ELECTRIC WATER HEATER
DETAILS WITH FOUNDATION
SECTION A-A SCALE 1:20**

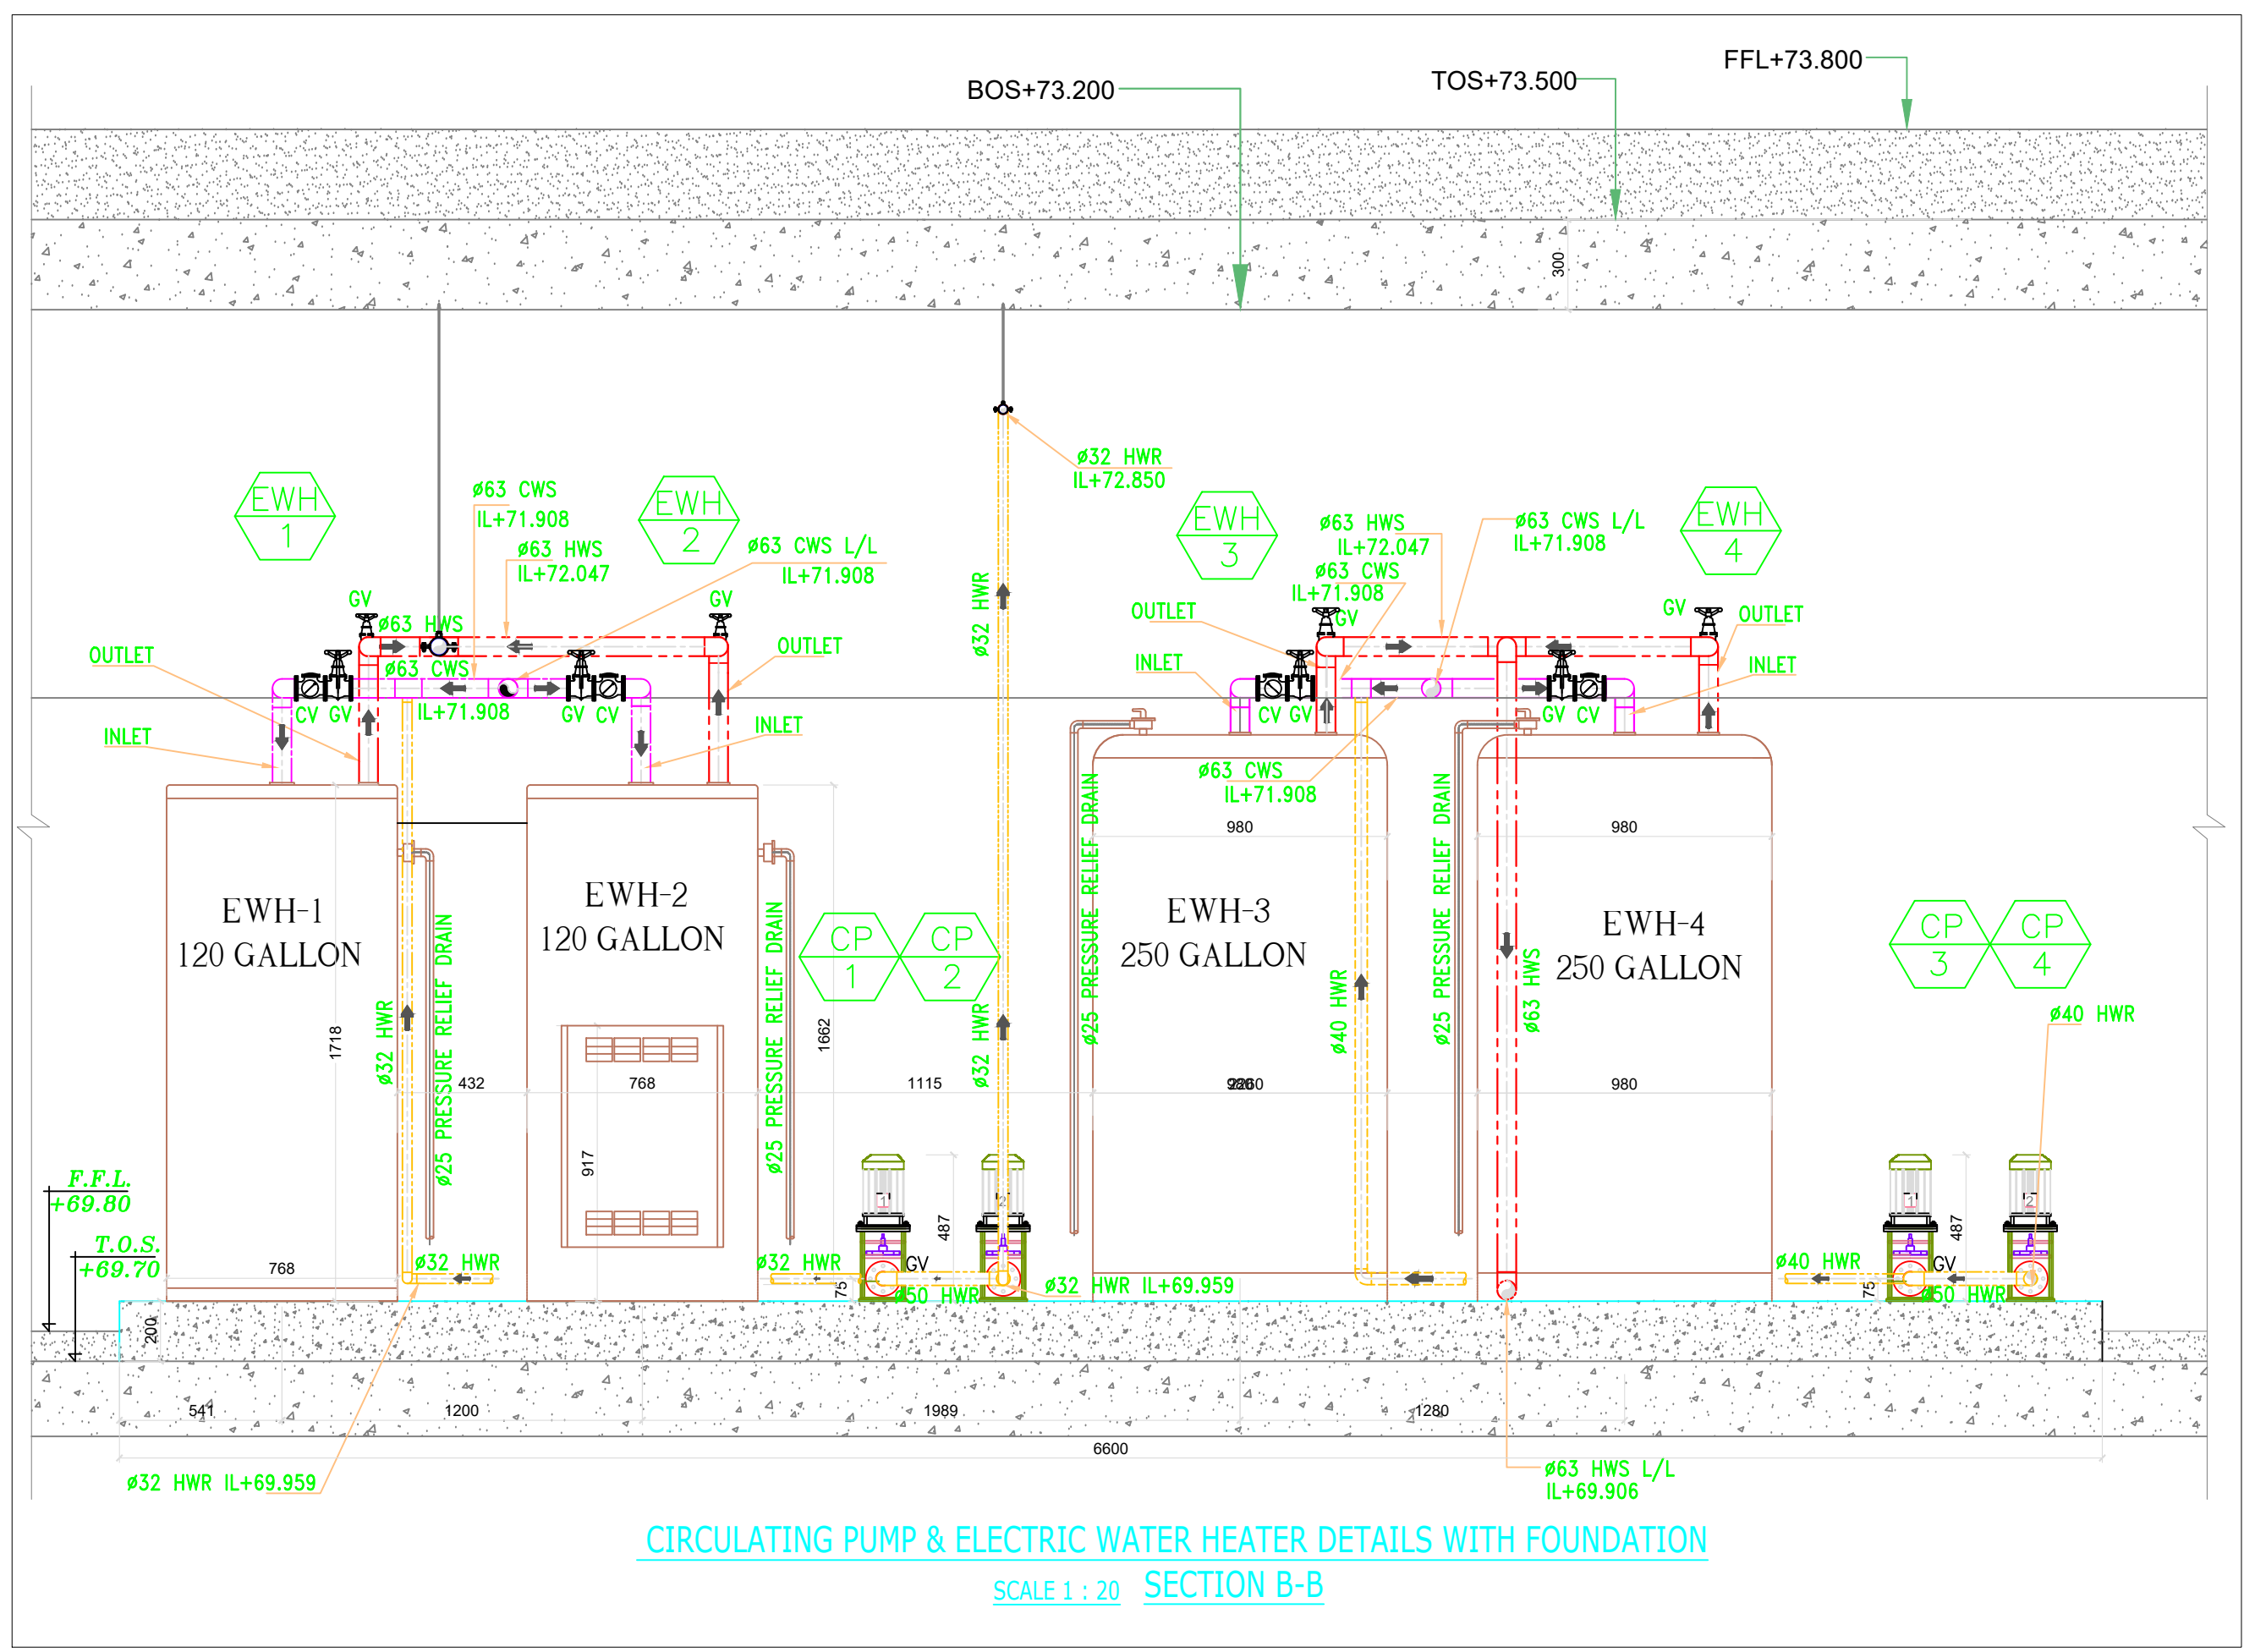


**CIRCULATING PUMP & ELECTRIC WATER HEATER DETAILS WITH FOUNDATION
SECTION B-B SCALE 1:20**

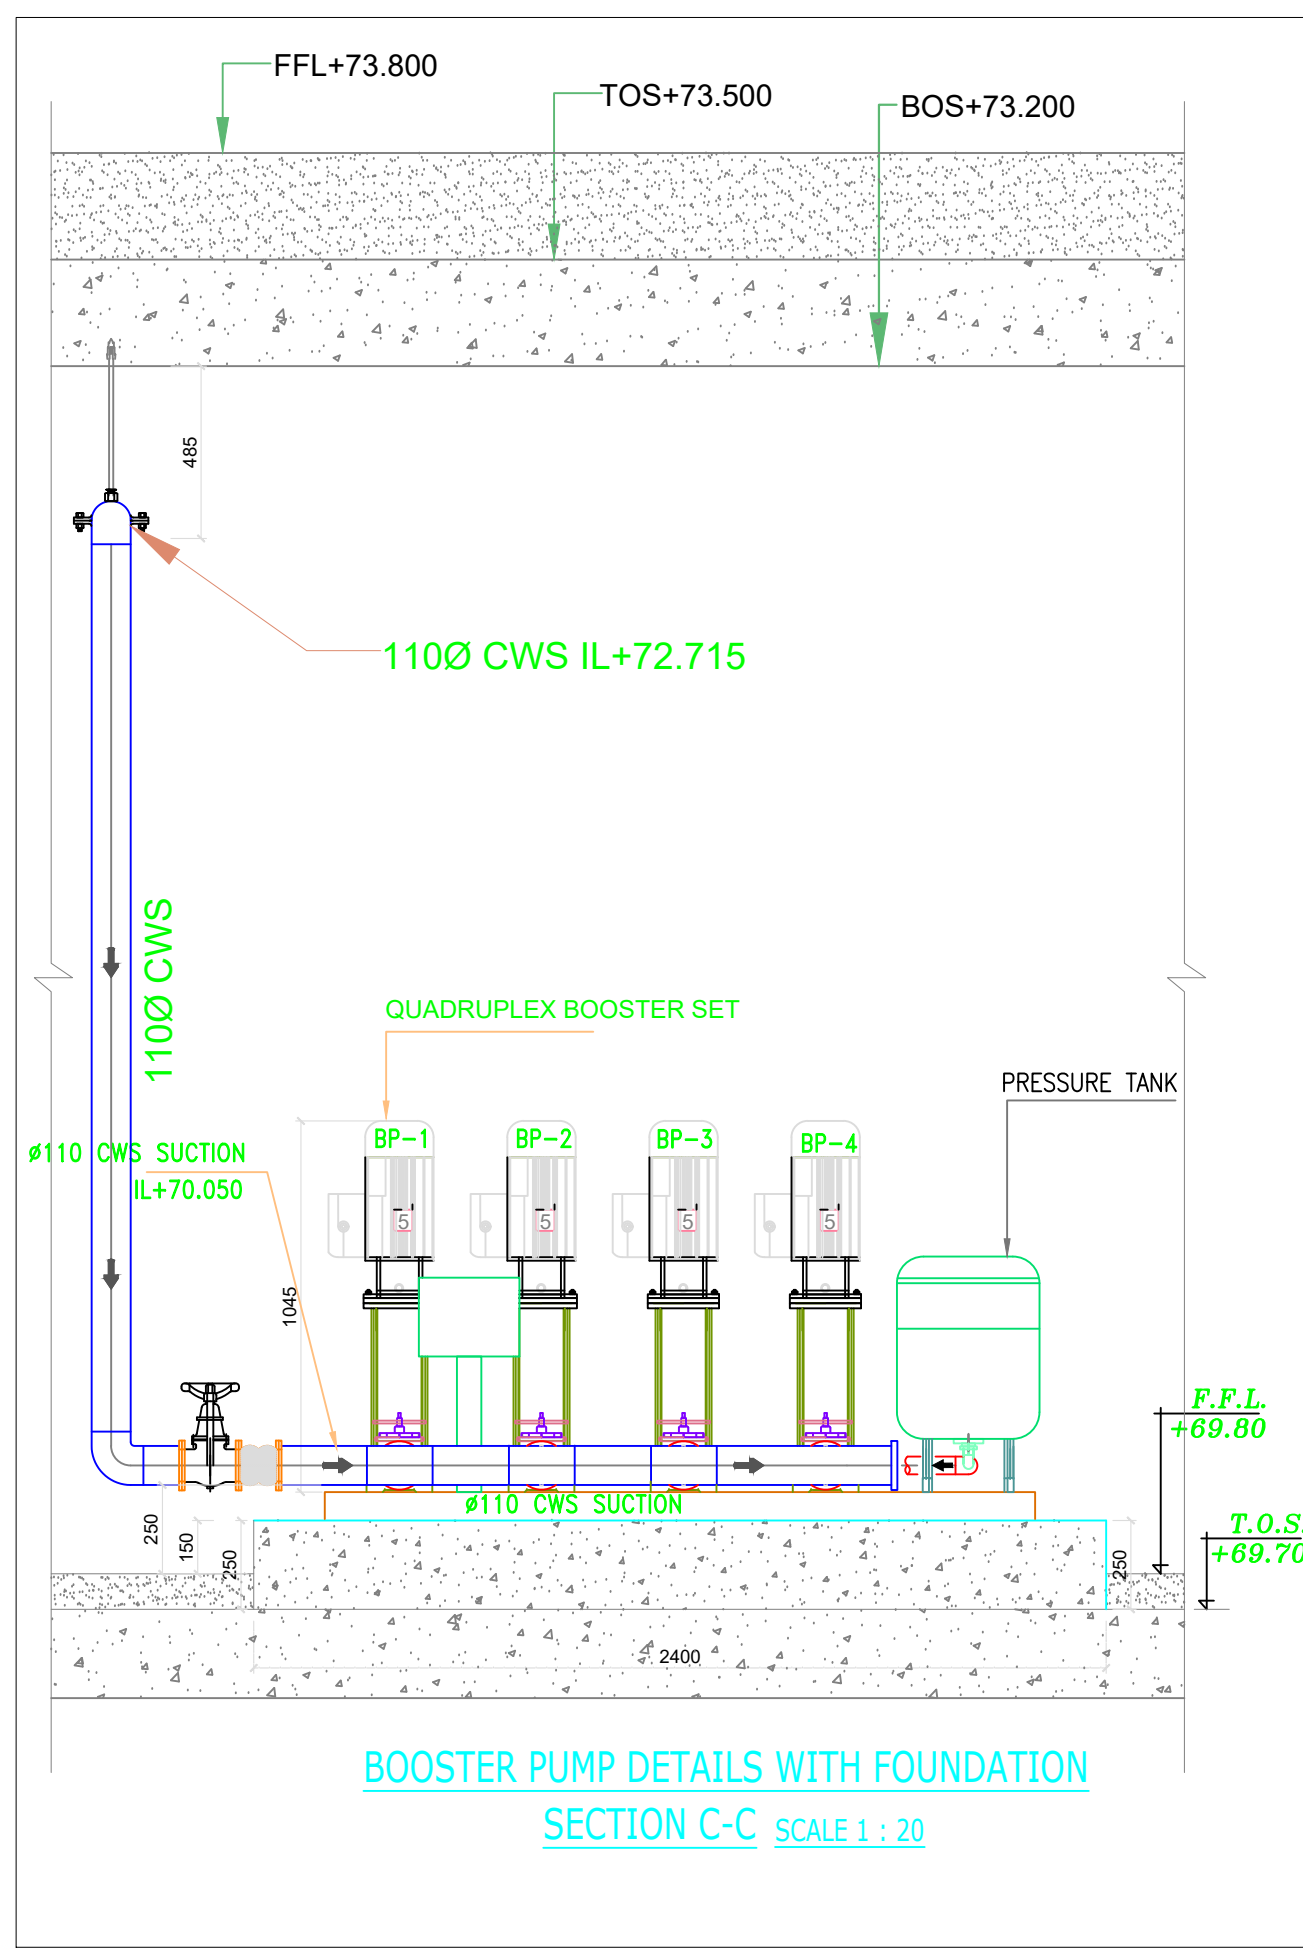

**BOOSTER PUMP DETAILS WITH FOUNDATION
SECTION C-C SCALE 1:20**

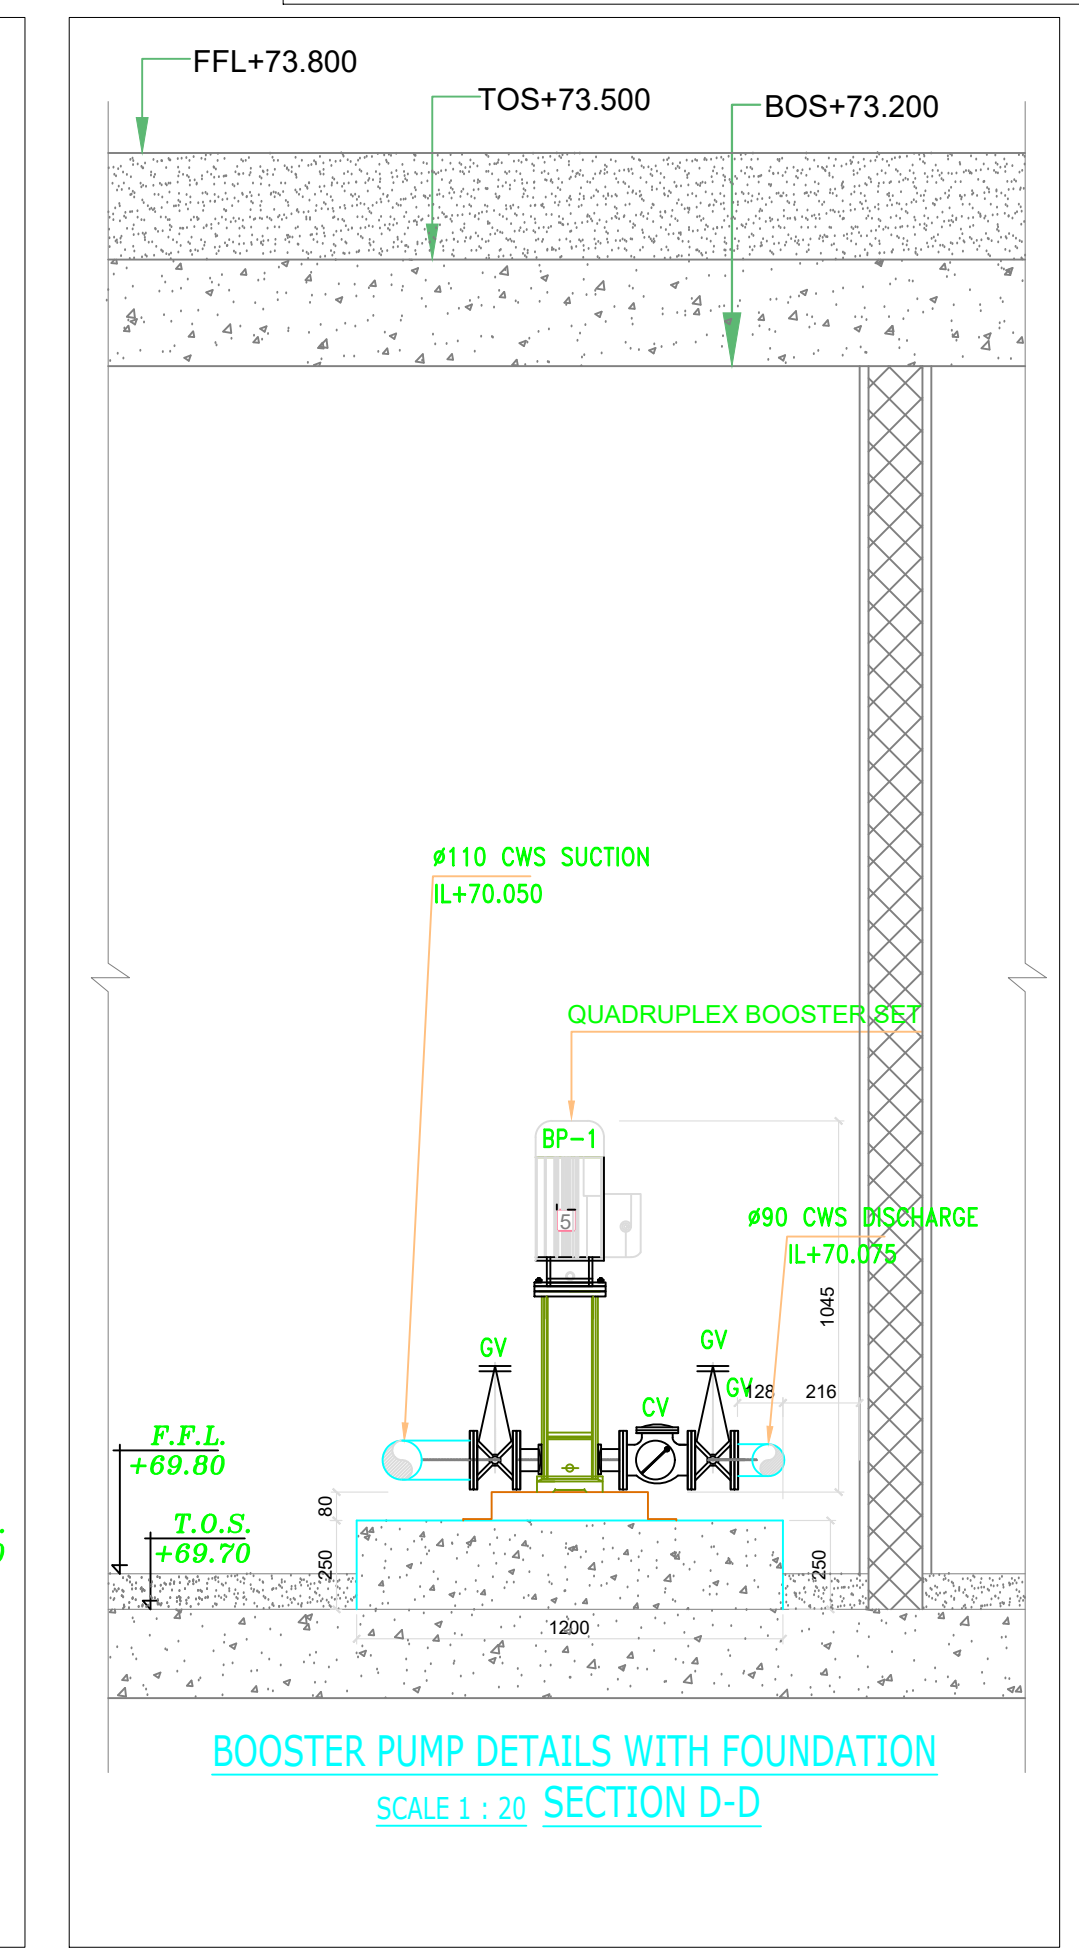

**BOOSTER PUMP DETAILS WITH FOUNDATION
SECTION D-D SCALE 1:20**

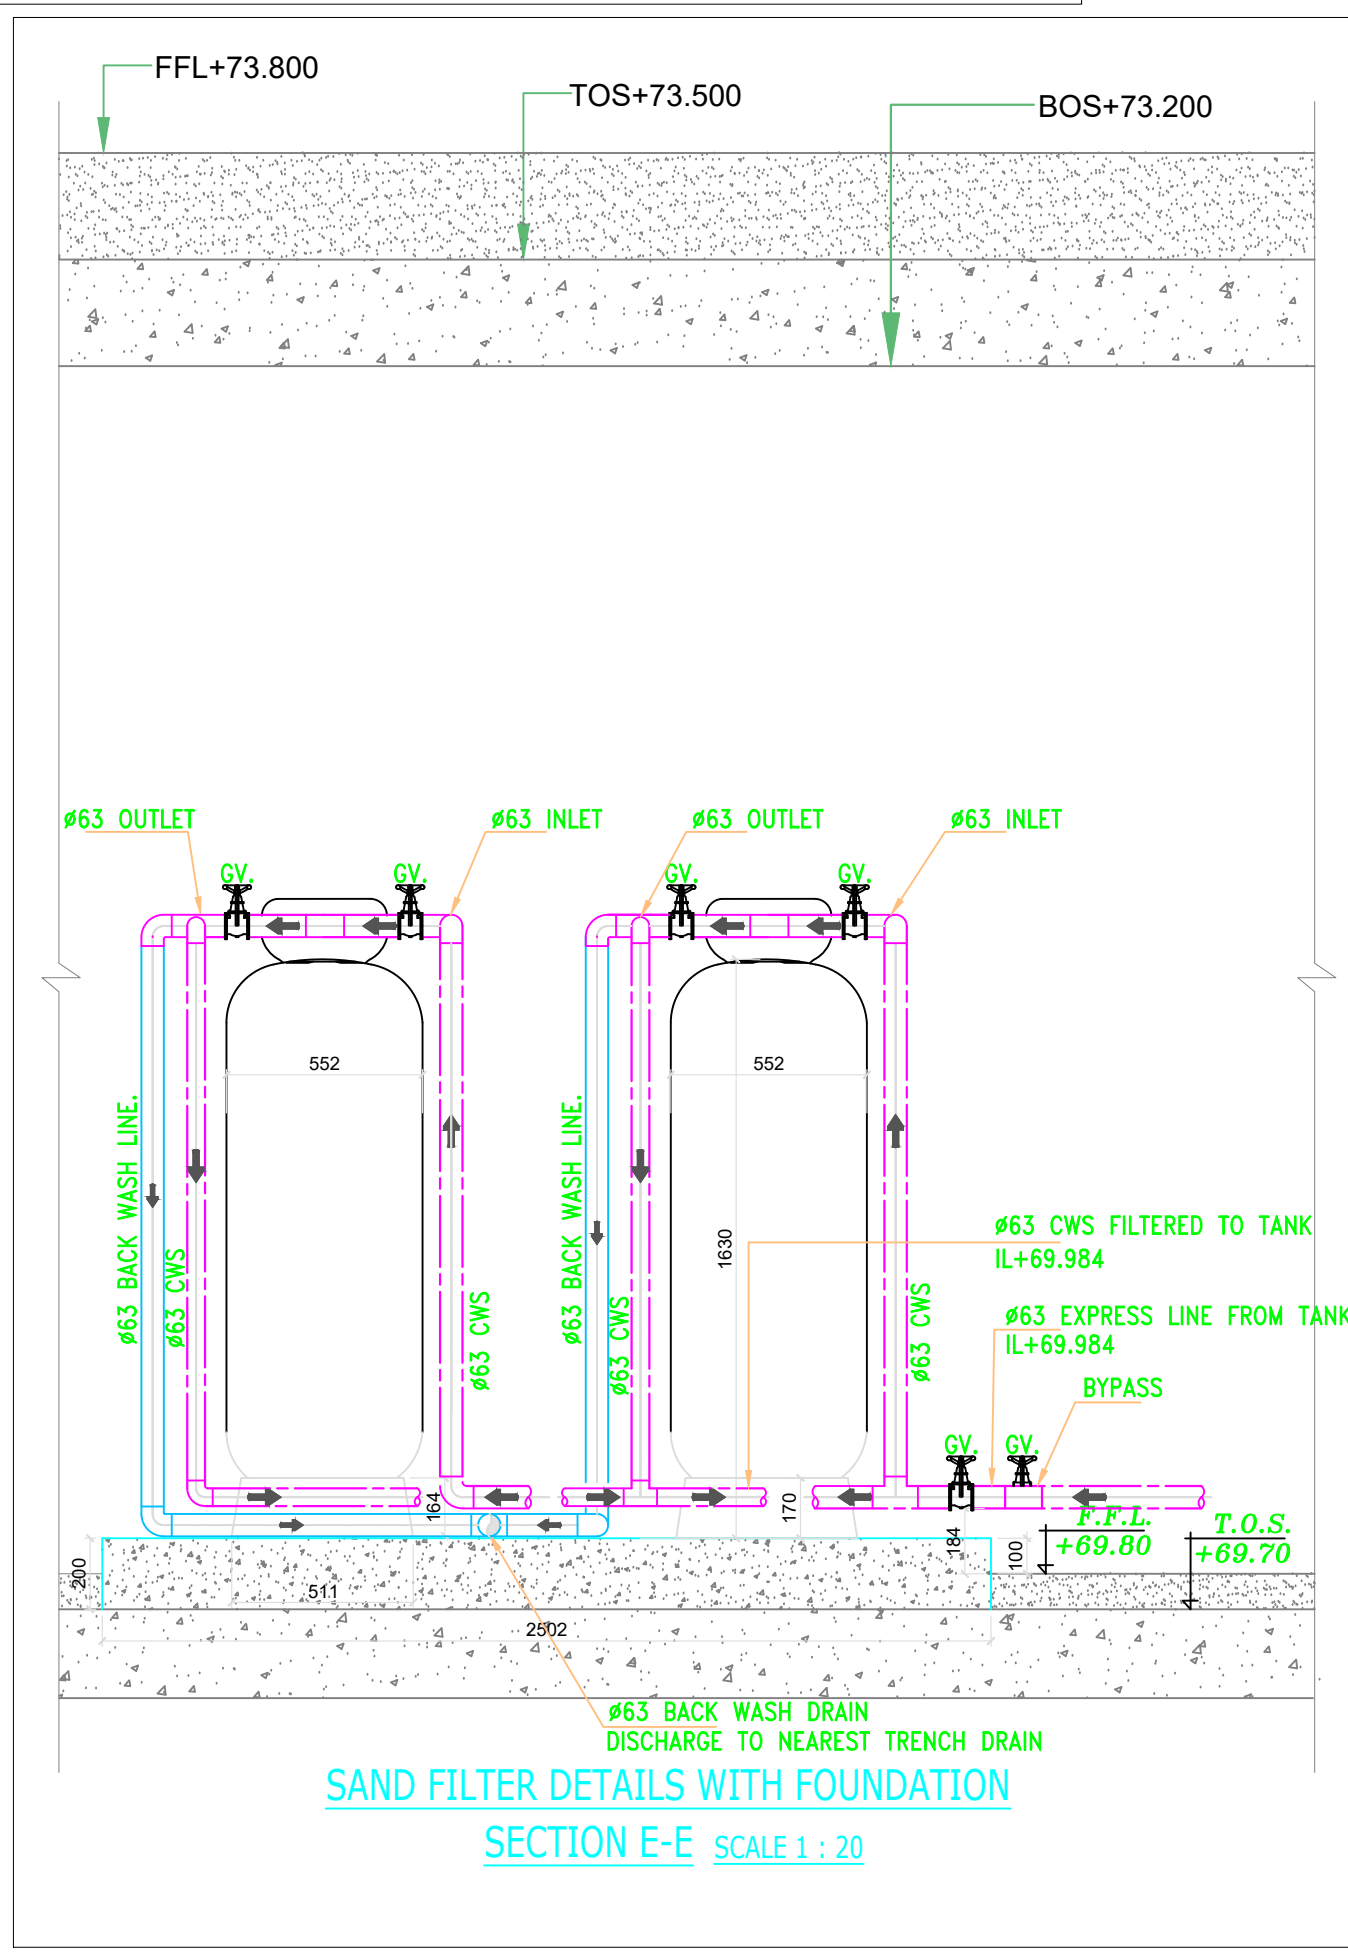

**SAND FILTER DETAILS WITH FOUNDATION
SECTION E-E SCALE 1:20**