



#10 SUPPLY MAIN PIPE 1.5"
#10 DR. WASTEWATER PIPE 1.5"

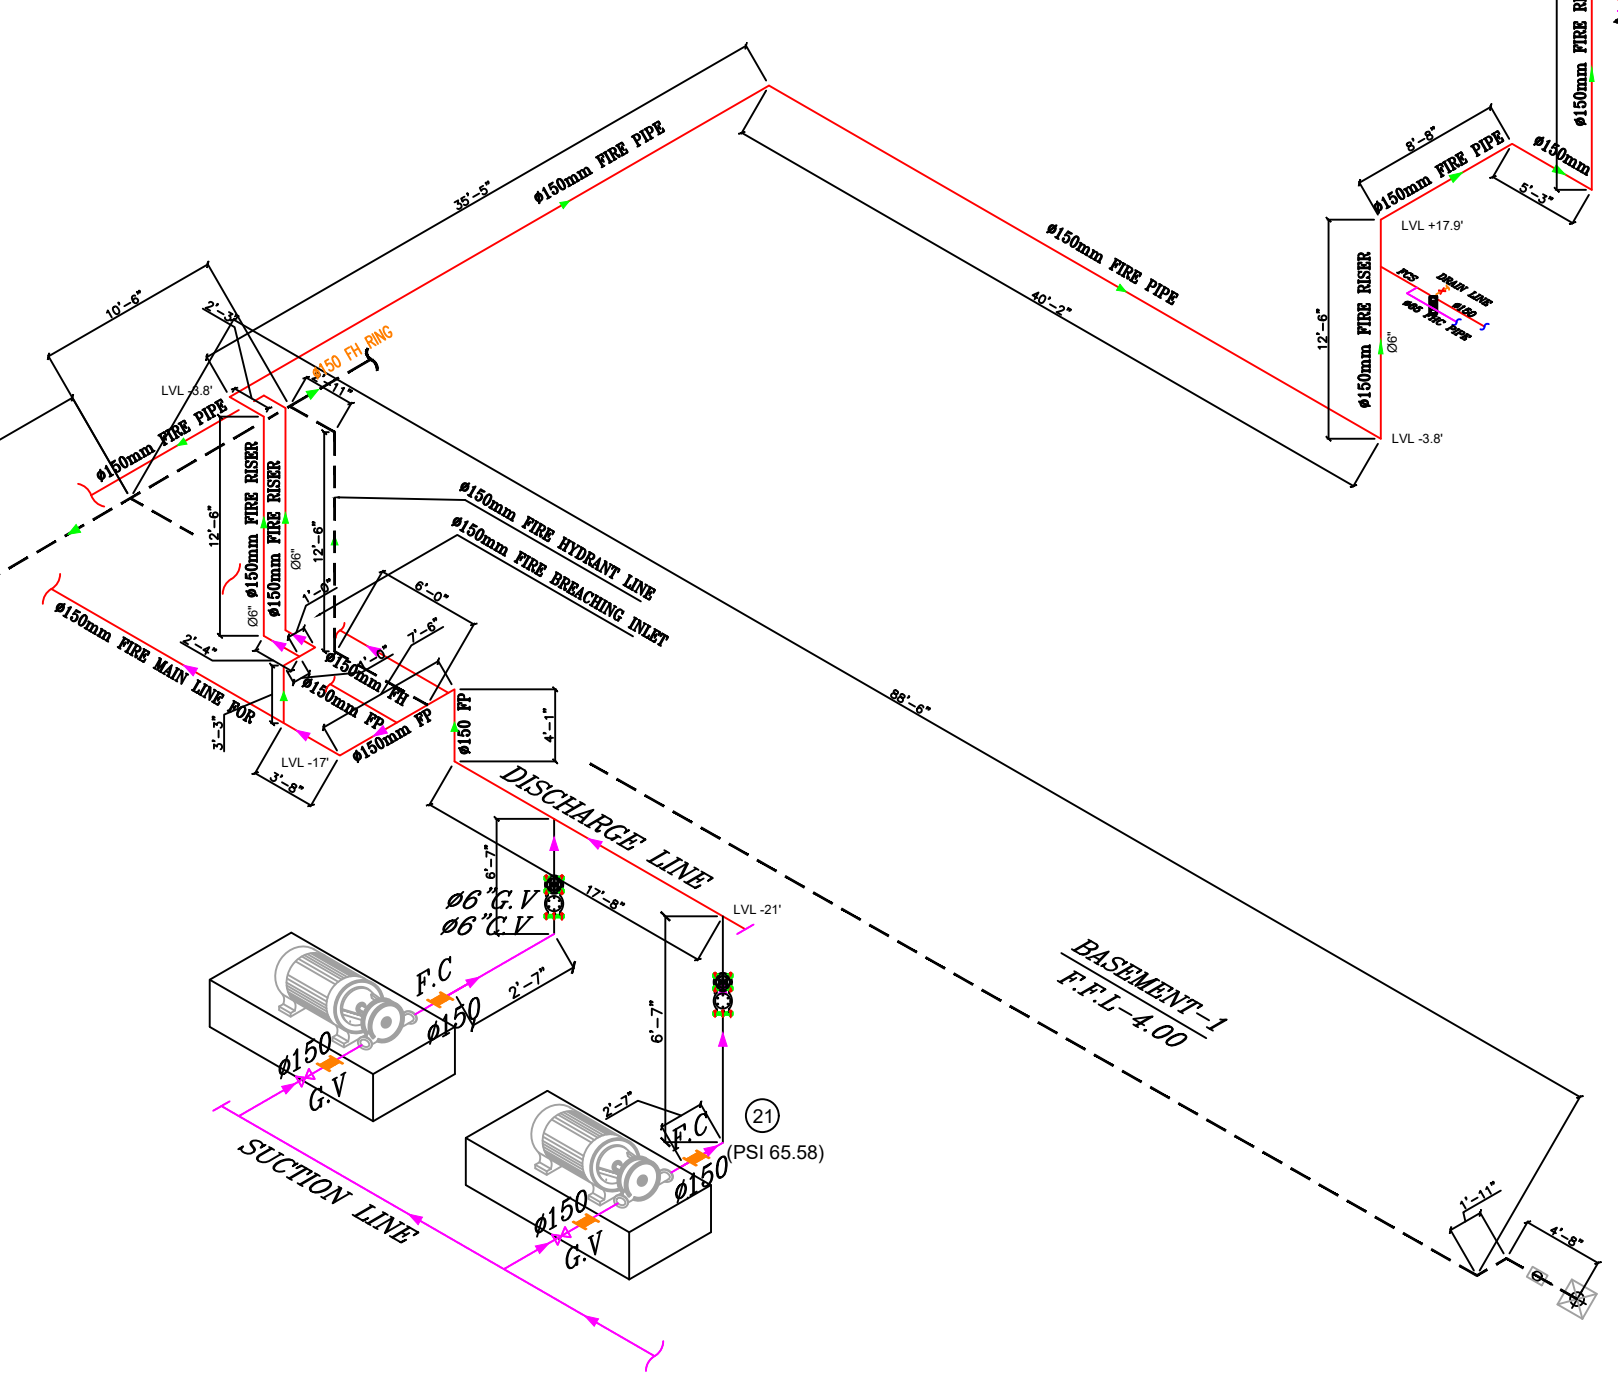

BASMENT-2
F.F.I. = 7.50'

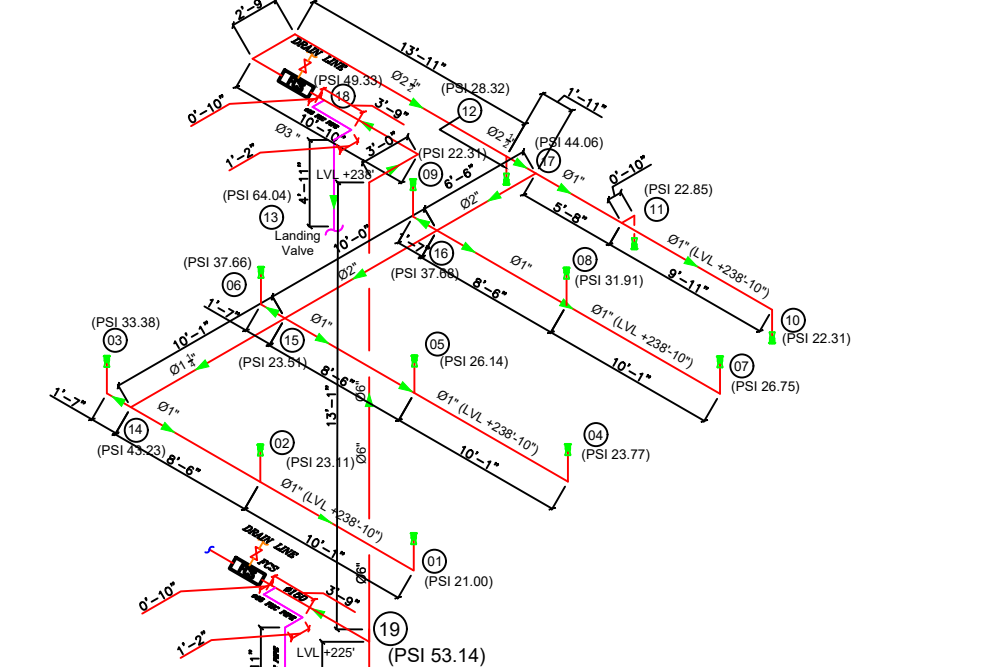

LEVEL - 17
F.F.I. = 49.00'

LEVEL - 16
F.F.I. = 48.00'

LEVEL - 15
F.F.I. = 47.00'

LEVEL - 14
F.F.I. = 46.00'

LEVEL - 13
F.F.I. = 45.00'

LEVEL - 12
F.F.I. = 44.00'

LEVEL - 11
F.F.I. = 43.00'

LEVEL - 10
F.F.I. = 42.00'

LEVEL - 9
F.F.I. = 41.00'

LEVEL - 8
F.F.I. = 40.00'

LEVEL - 7
F.F.I. = 39.00'

LEVEL - 6
F.F.I. = 38.00'

LEVEL - 5
F.F.I. = 37.00'

LEVEL - 4
F.F.I. = 36.00'

LEVEL - 3
F.F.I. = 35.00'

LEVEL - 2
F.F.I. = 34.00'

LEVEL - 1
F.F.I. = 33.00'

GROUND FLOOR
F.F.I. = 32.00'